
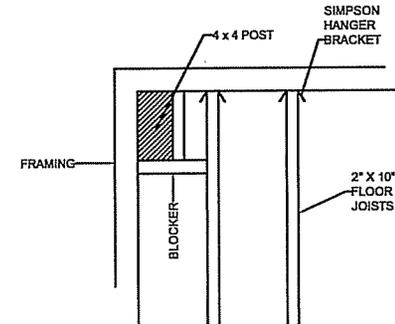


# EXAMPLE OF RESIDENTIAL DECK & STAIR DETAILS

**GUARDRAIL MIN - 36" HIGH**

**\*4 x 4 POST SET IN DECK BLOCKED & NAILED OR SCREWED NO NOTCH**

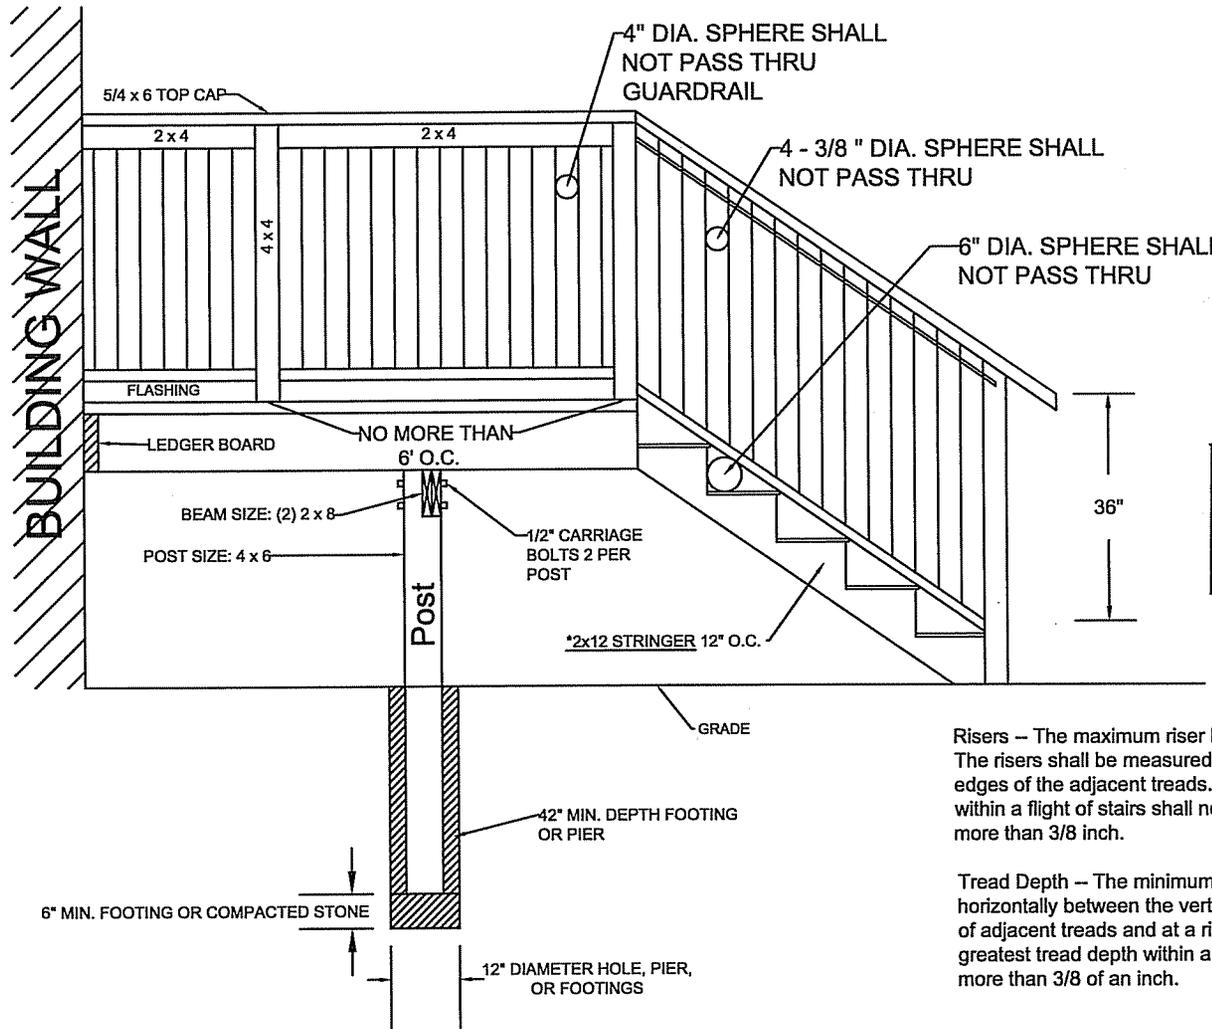

**\*GRASPABLE HANDRAIL (1) SHALL BE CONTINUOUS, 34" TO 38" ABOVE PLANE OF STAIR NOSINGS, WITH ENDS RETURNED TO POST OR GUARDRAIL**

**Risers** – The maximum riser height shall be 8 -1/4 inches. The risers shall be measured vertically between leading edges of the adjacent treads. The greatest riser height within a flight of stairs shall not exceed the smallest by more than 3/8 inch.

**Tread Depth** – The minimum depth shall be 9 inches, measured horizontally between the vertical planes (nosings) of the foremost projection of adjacent treads and at a right angle to the tread's leading edge. The greatest tread depth within a flight of stairs shall not exceed the smallest by more than 3/8 of an inch.

**NOTE:** Nosings are not required where the tread depth is a minimum of 11 inches.